

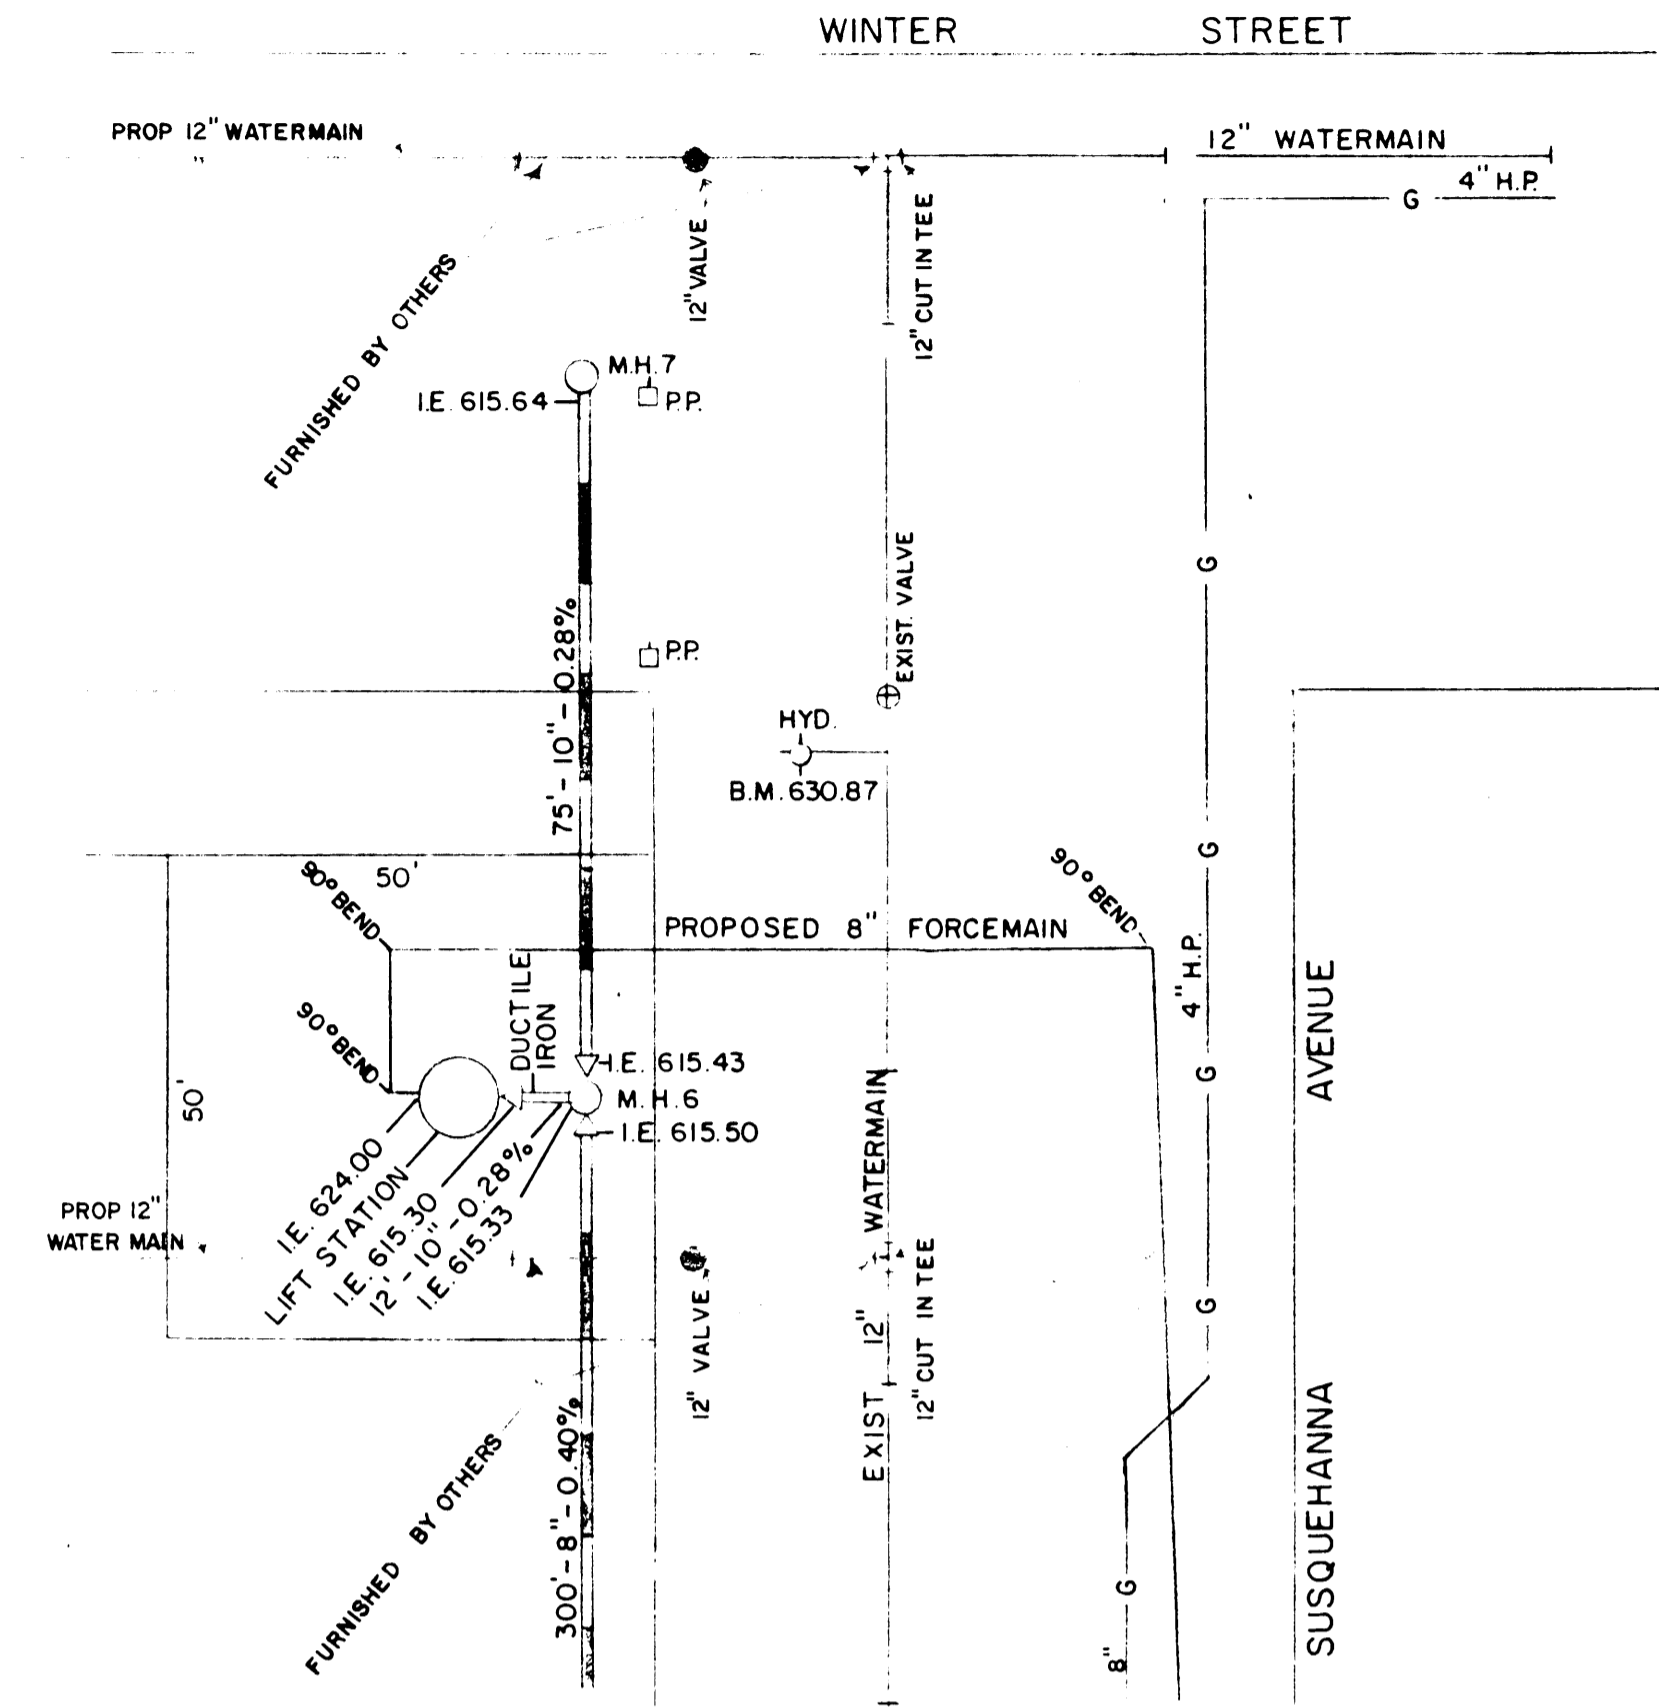


CAUTION
LEVEL 2 CONFINED SPACE
DO NOT ENTER WITHOUT PROPER EQUIPMENT
SIGN TO BE ATTACHED TO PLYWOOD

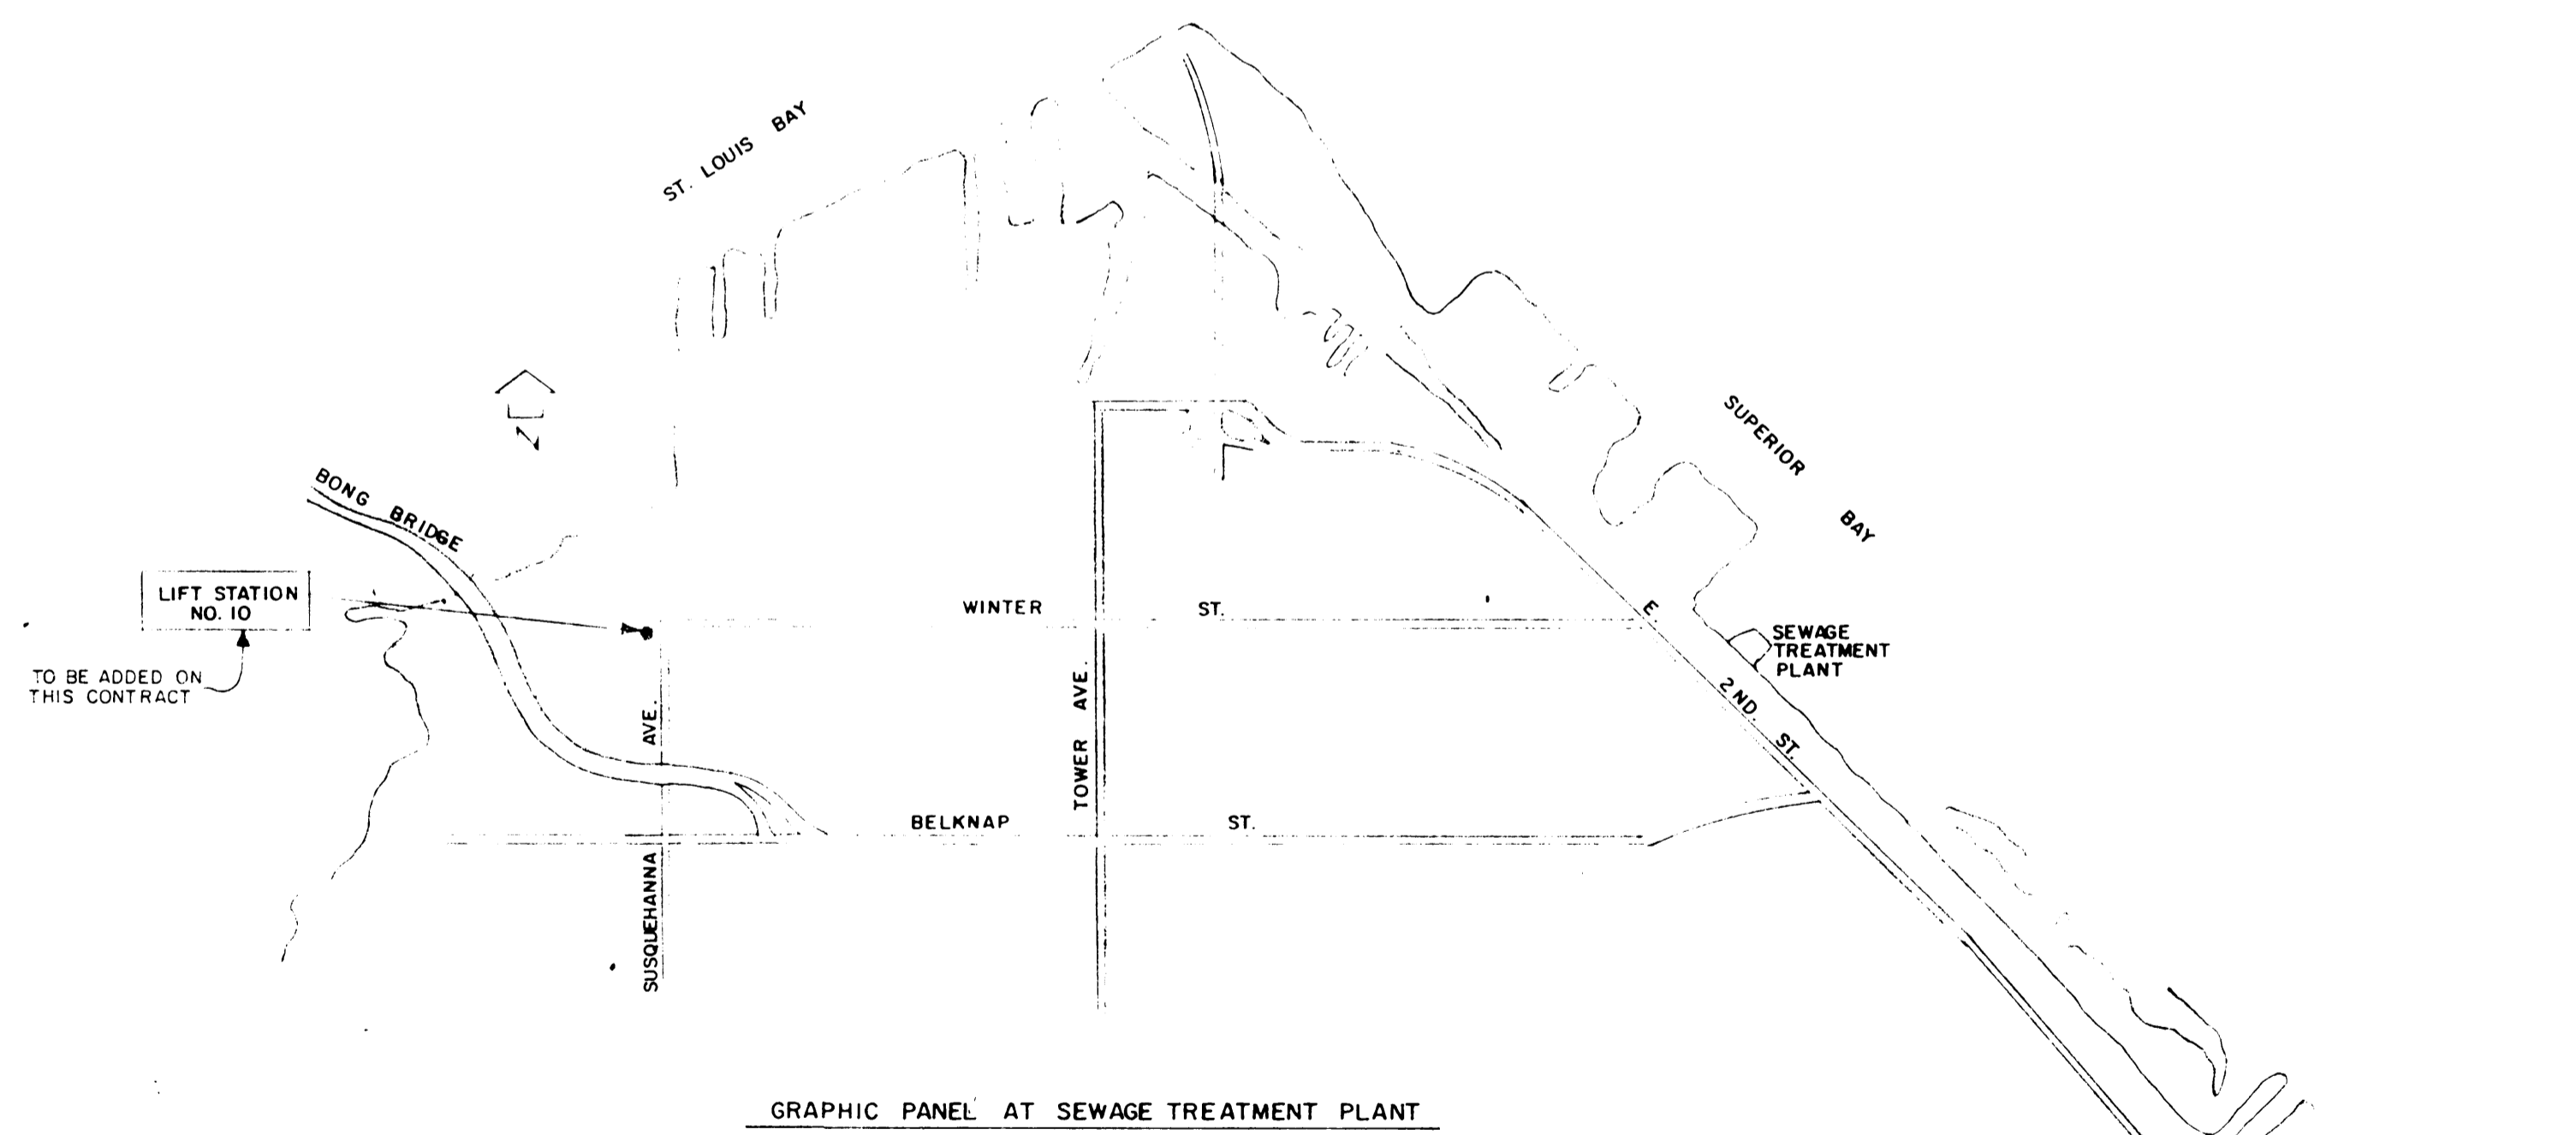

Clayton G. Connell

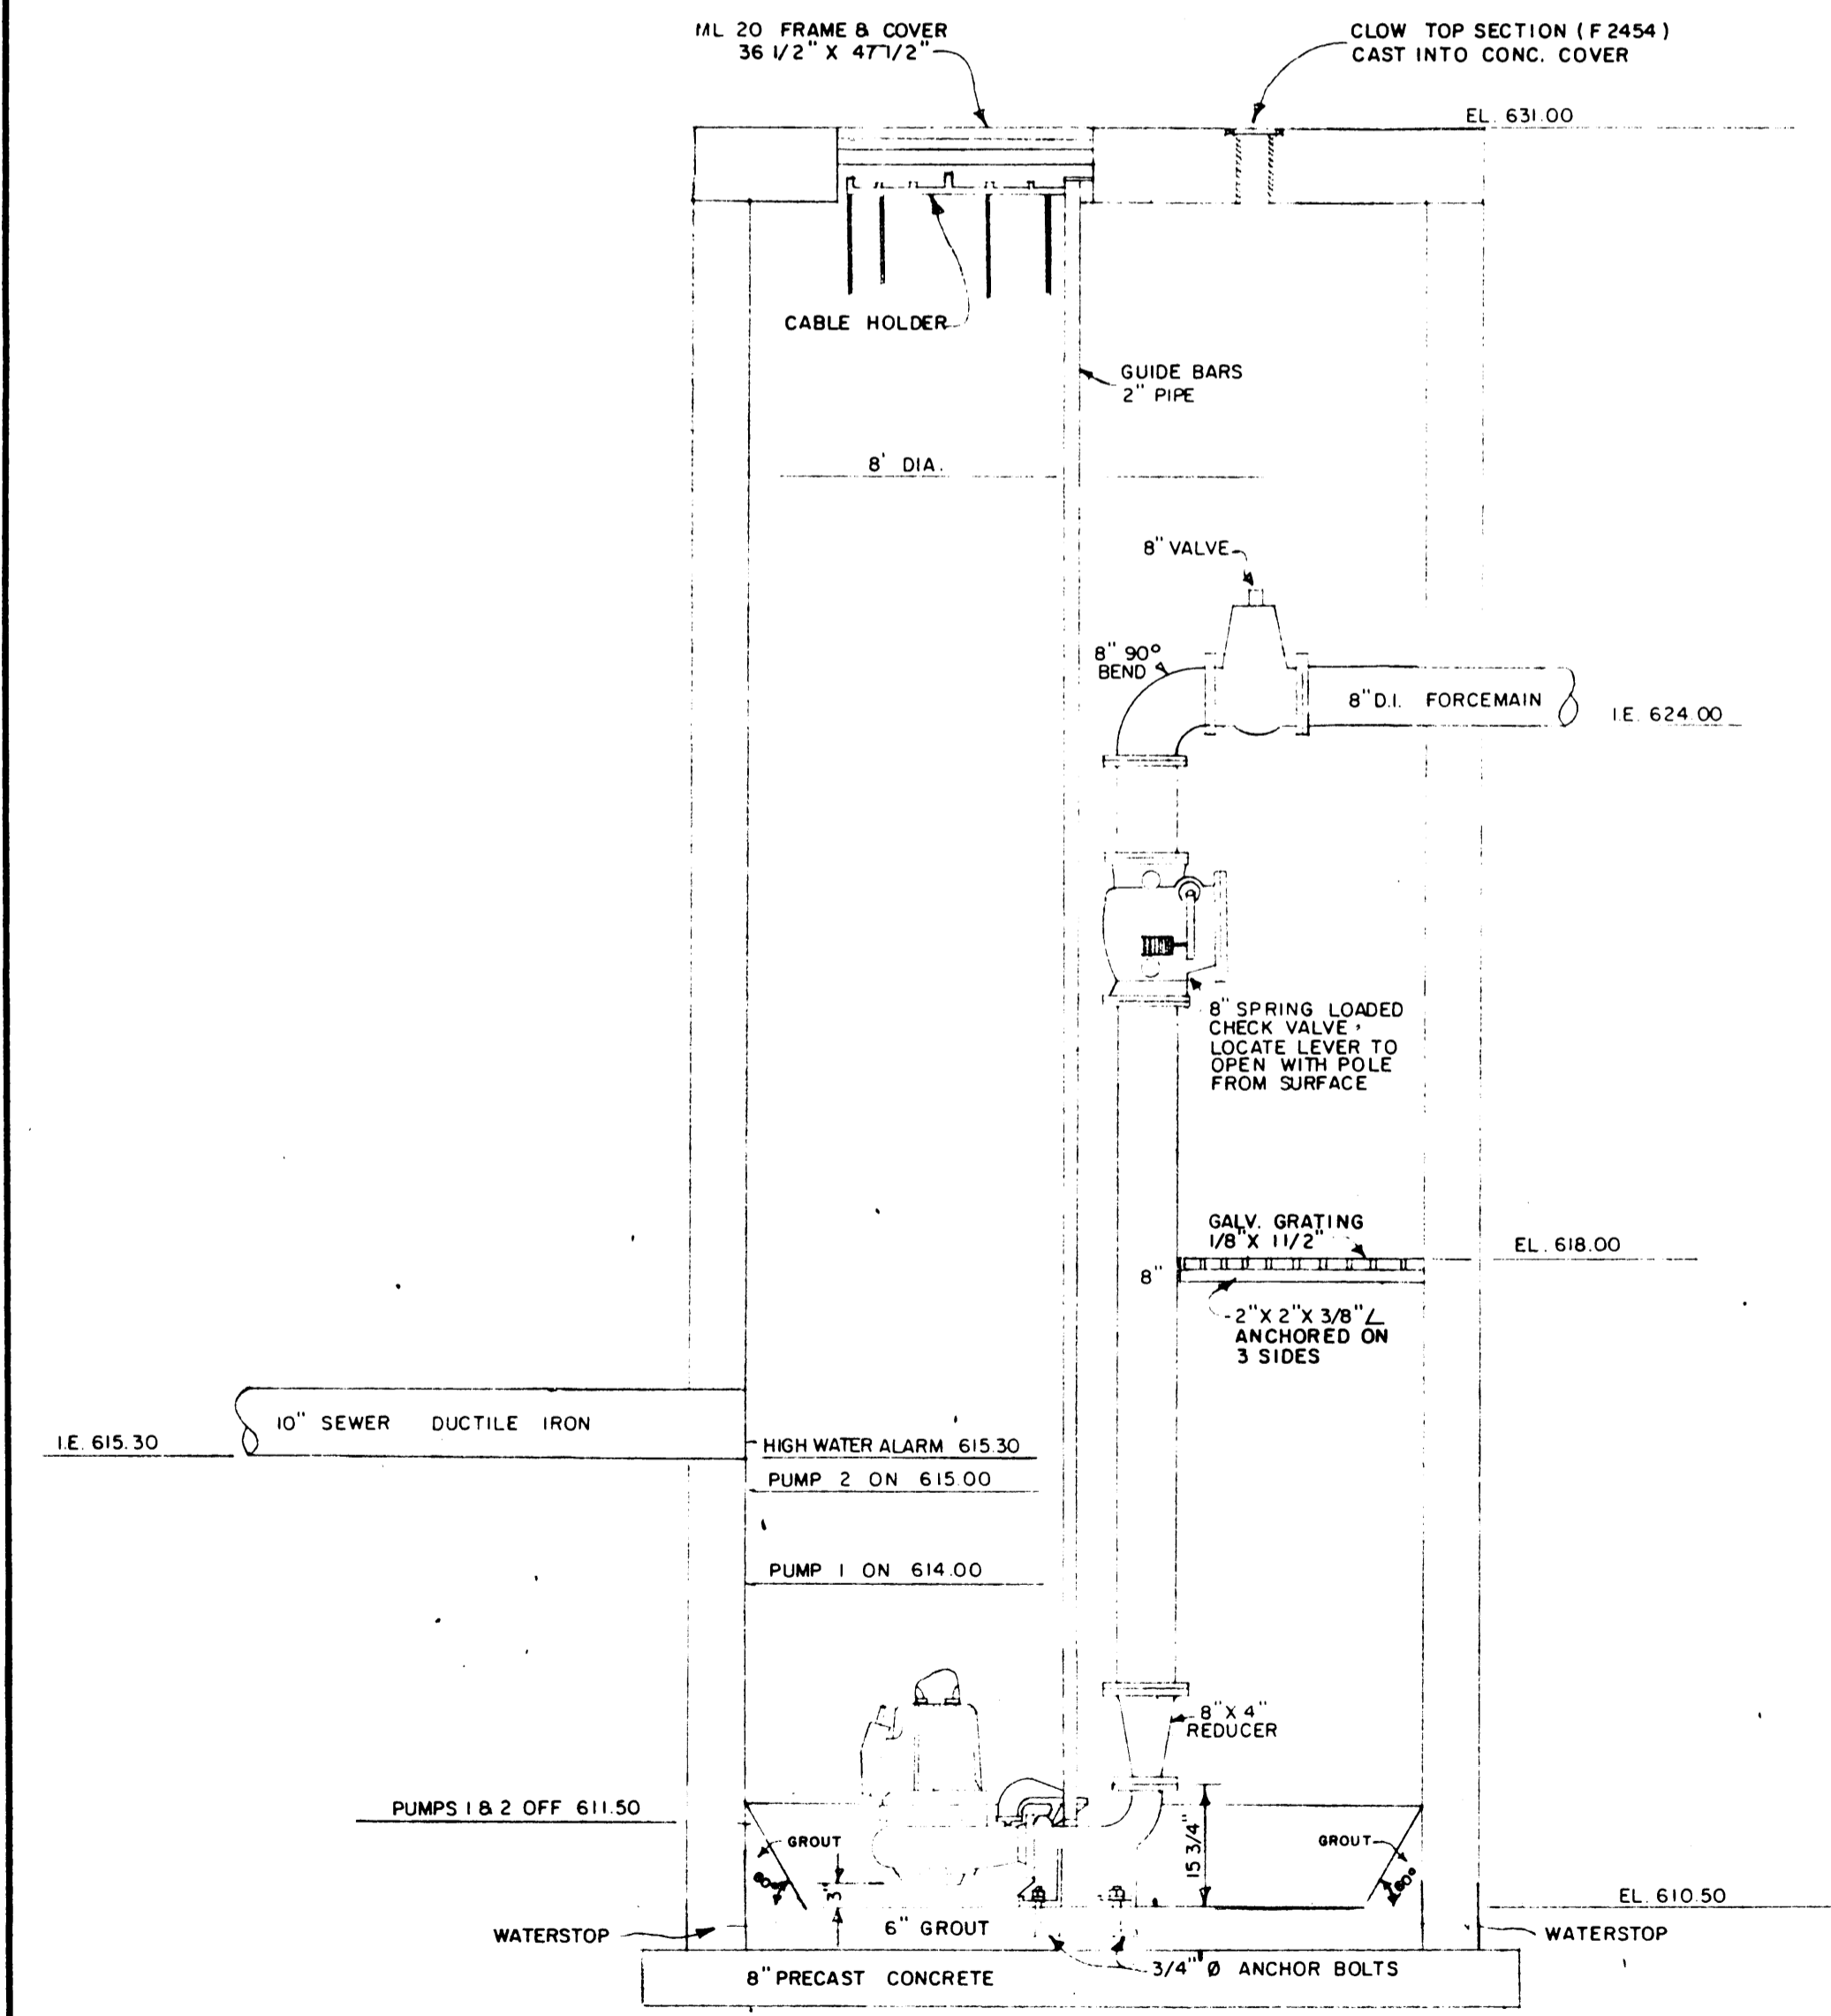

PUMPS
2 - 485 GPM PUMPS AT 37 TDH
2 - 10 HP MOTORS
240/480 VOLT 3 PHASE 60 CYCLE
DISCHARGE PRESSURE GAUGE READING IN FEET, 0 - 50 FEET

PUMP DESIGN
DISCHARGE ELEV. — 630.42
SHUT-OFF ELEV. — 611.50
STATIC HEAD — 18.92
STATION LOSS — 4.80
485 GPM IN 1690' - 8" D.I. — 13.25
TOTAL — 36.97
USE — 37.00
(C = 100)

PUMP NO. 1	<input type="radio"/>	RUNNING
PUMP NO. 2	<input type="radio"/>	RUNNING
HIGH OR LOW LEVEL	<input type="radio"/>	ALARM
POWER FAILURE SIGNAL FAILURE	<input type="radio"/>	ALARM
SIGNAL FAILURE	<input type="radio"/>	ALARM
SIGNAL	<input type="radio"/>	PARITY OK

PUMP NO. 1 HOUR METER
PUMP NO. 2 HOUR METER

REMOTE RECEIVER AT SEWAGE TREATMENT PLANT

SPARE SPACE PROVIDED FOR REMOTE RECEIVER IN EXISTING BOARD. EXISTING LOW TEMPERATURE SENSOR WILL HAVE TO BE RELOCATED TO A POSITION ABOVE THE MOUNTING FOR EXISTING L.S. #9.

NEW WAREHOUSE BUILDING GATEWAY FOODS/TWIN PORTS WAREHOUSE PHASE III, EDA WORK: RAILROAD SPUR WORK SANITARY SEWER/FORCE MAIN/LIFT STATION WORK SUPERIOR, WISCONSIN		
EDA PROJ NO. 2001-01-01224		
DRAWN BY	E. T. C., INC. MUNICIPAL & INDUSTRIAL ENGINEERS LA CROSSE - WISCONSIN	SCALE AS SHOWN
CHECKED BY	DATE FEBRUARY 26, 1987	REVISION 23 SB v. RR
APPROVED BY	JOB NO. E-162	SHEET NO. CE 8 of 8

REVISED: