


REVIEWED AND APPROVED BY THE
 DIV. OF ENVIRONMENTAL PROTECTION,
 DEPT. NATURAL RESOURCES,
 IN ACCORDANCE WITH SEC. 144.01,
 WIS. STATS., SUBJECT TO THE
 CONDITIONS SET FORTH IN THE LETTER
 OF APPROVAL.
 THOMAS G. FRANGOS
 ADMINISTRATOR

APPROVAL NO.
 72 355
 DATE: FEB 4 '74
 DNR JAN 3 1974

SURVEY	REVISIONS	BONESTRO, ROSENE, ANDERLIK & ASSOC., INC. ST. PAUL, MINNESOTA	SUPERIOR, WISCONSIN DATE: FEBRUARY 2, 1974 COMM. 6888 A	AERATION TANKS SECTIONS SHEET 27/64
DRAWN	1/11/74 Added 30" D.I.P. & 30" Base Ell			
DESIGN	1/11/74			
APPROVED	1/11/74			

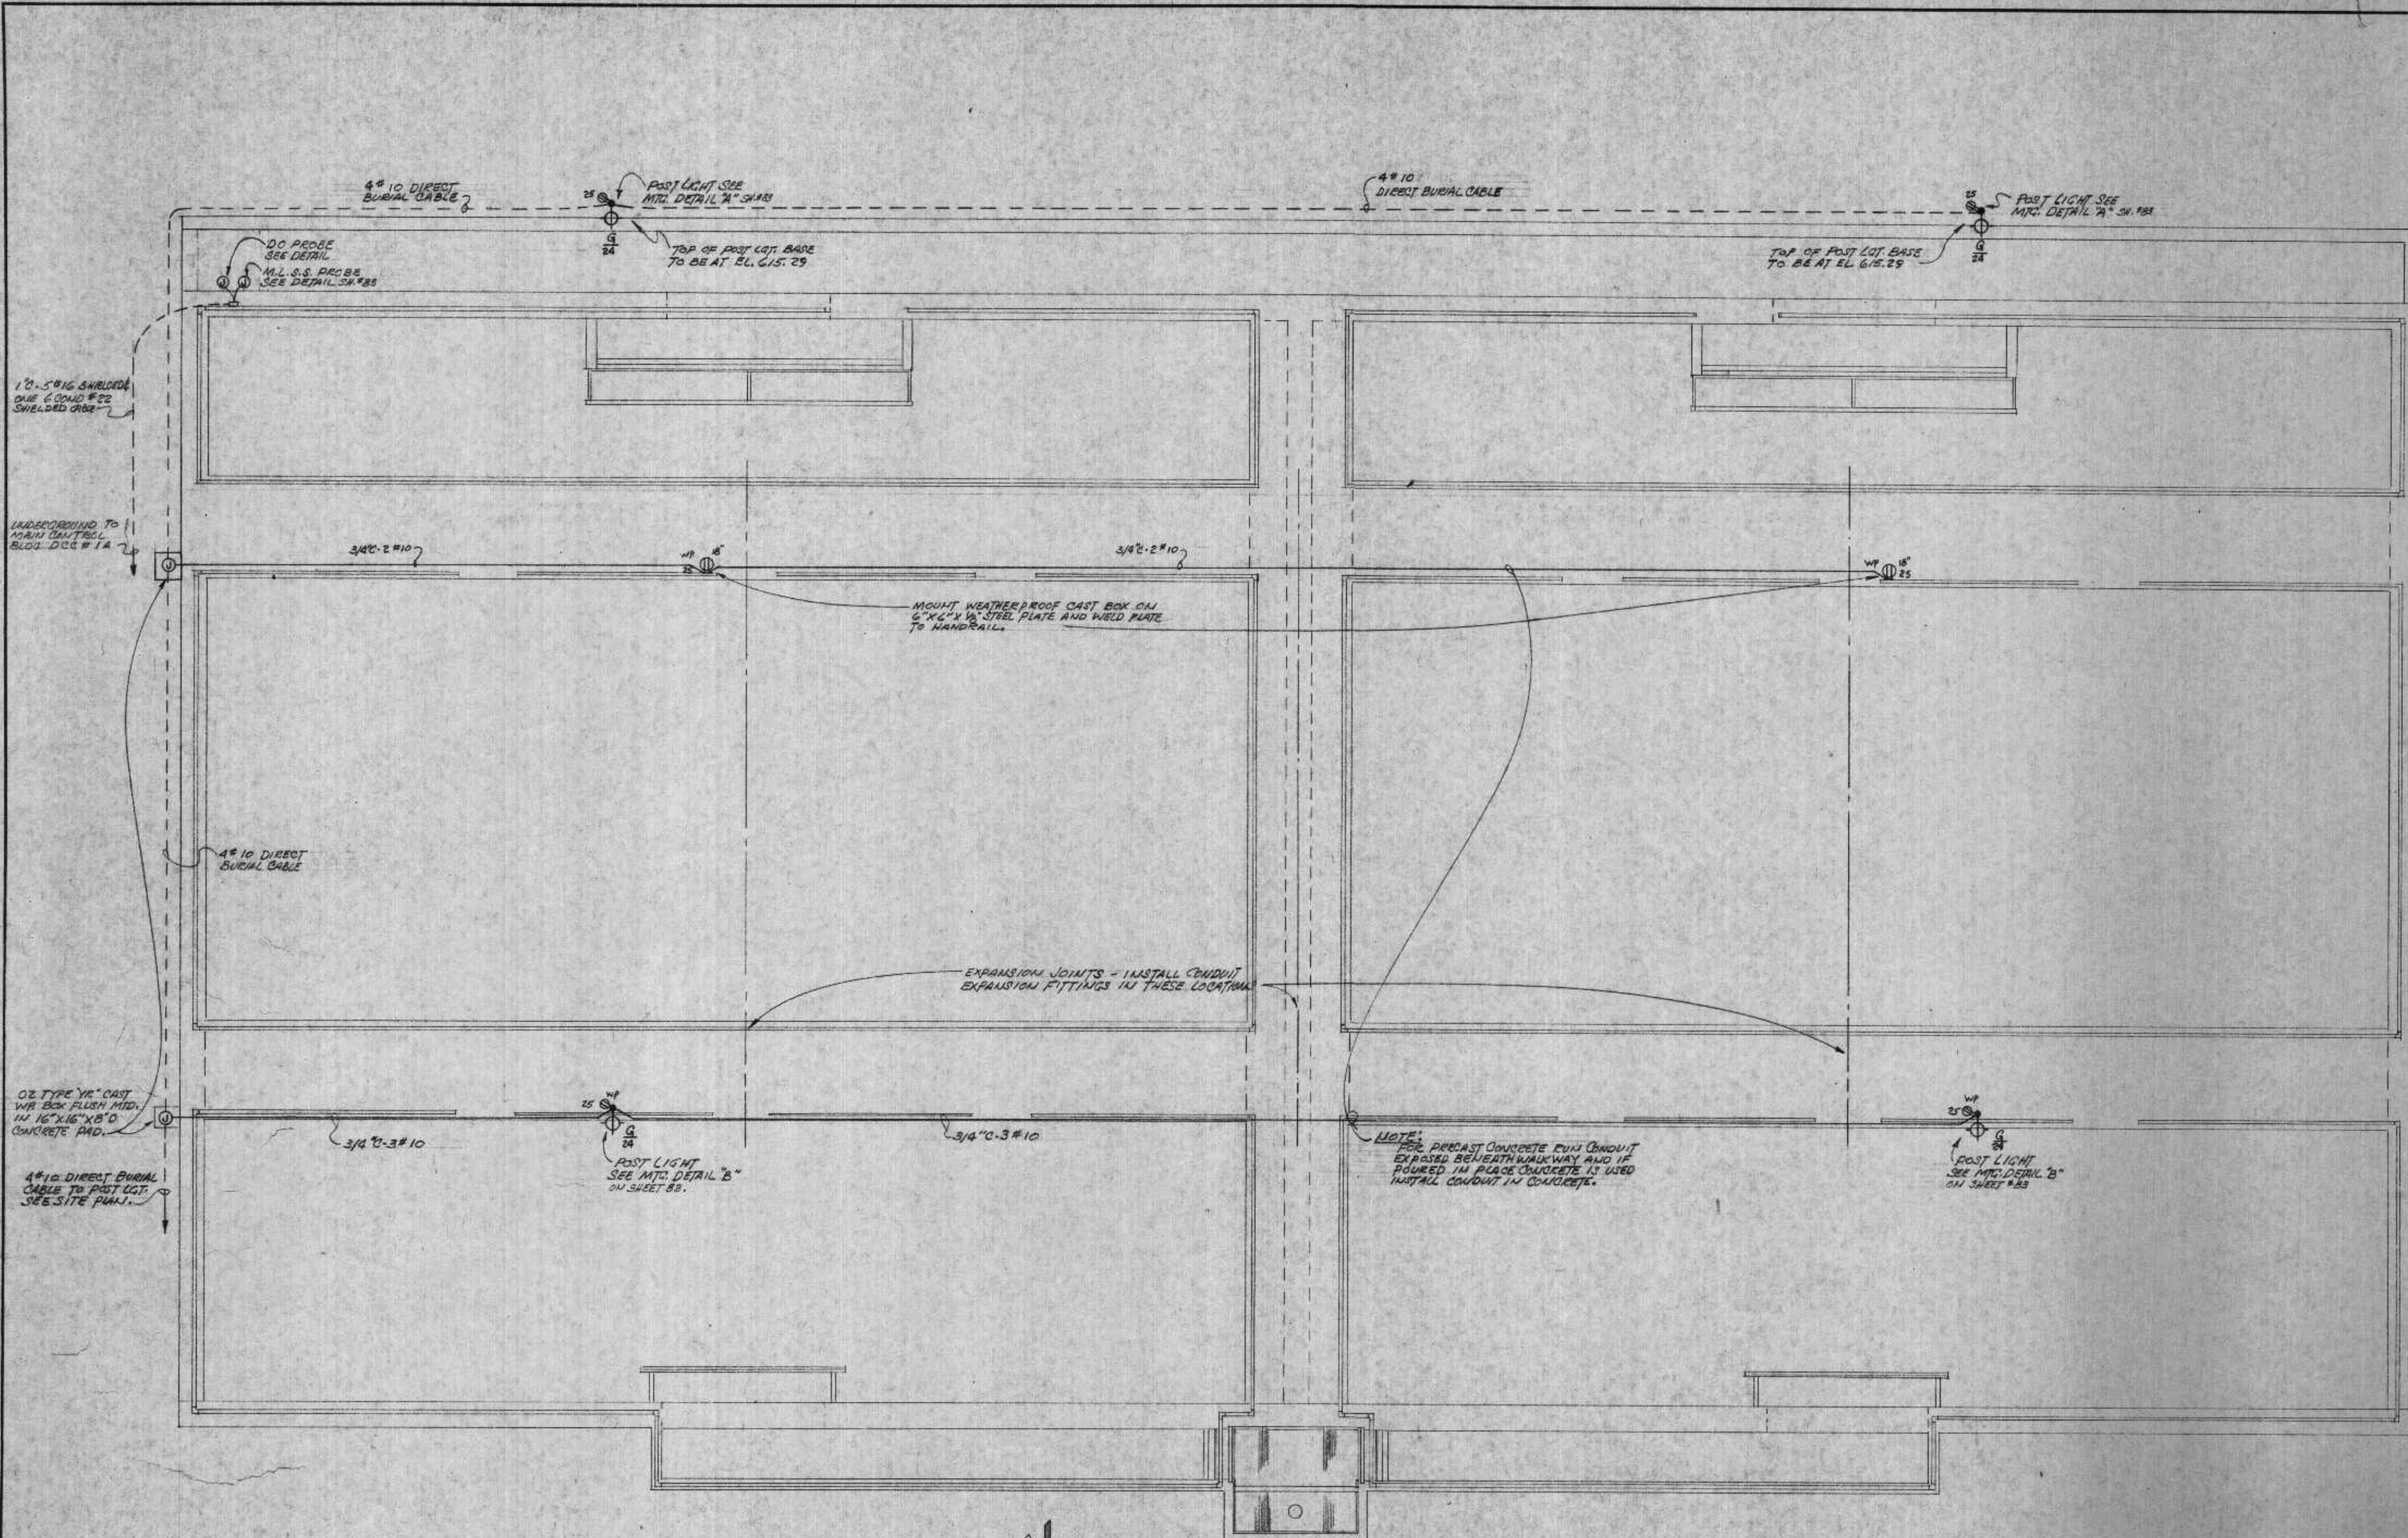

4" 10 DIRECT BURIAL CABLE
 POST LIGHT SEE MTC DETAIL "A" SH #83
 TOP OF POST LOT BASE TO BE AT EL. 615.25
 4" 10 DIRECT BURIAL CABLE
 POST LIGHT SEE MTC DETAIL "A" SH #83
 TOP OF POST LOT BASE TO BE AT EL. 615.25

1" 5/8" SHROUD ONE CONDUIT #22 SWELED CABLE
 UNDERGROUND TO MAIN CONTROL BLDG. SEE # 1A
 3/4" 2 #10
 3/4" 2 #10
 18" WF
 18" WF

MOUNT WEATHER PROOF CAST BOX ON 6" X 6" X 1/2" STEEL PLATE AND WELD PLATE TO HANDRAIL

EXPANSION JOINTS - INSTALL CONDUIT EXPANSION FITTINGS IN THESE LOCATIONS

02 TYPE "A" CAST W/ BOX FLUSH MID. IN 16" X 16" X 8" D CONCRETE PAD.
 4" 10 DIRECT BURIAL CABLE TO POST LGT. SEE SITE PLAN.
 18" WF
 18" WF
 3/4" 3 #10
 3/4" 3 #10
 NOTE: FOR PRECAST CONCRETE RUN CONDUIT EXPOSED BENEATH WALKWAY AND IF POURED IN PLACE CONCRETE IS USED INSTALL CONDUIT IN CONCRETE.
 POST LIGHT SEE MTC DETAIL "B" ON SHEET #83




AERATION TANKS
 SCALE: 1/4" = 1'-0"

REVIEWED AND APPROVED BY THE
 DIV. OF ENVIRONMENTAL PROTECTION
 WIS. DEPT. NATURAL RESOURCES
 IN ACCORDANCE WITH SEC. 144.04,
 WIS. STATS., SUBJECT TO THE CON-
 DITIONS SET FORTH IN THE LETTER
 OF APPROVAL.
 THOMAS G. FRANGOS
 ADMINISTRATOR

APPROVAL NO. 355
 72
 DATE: FEB 4 '74

DNR JAN 3 1974

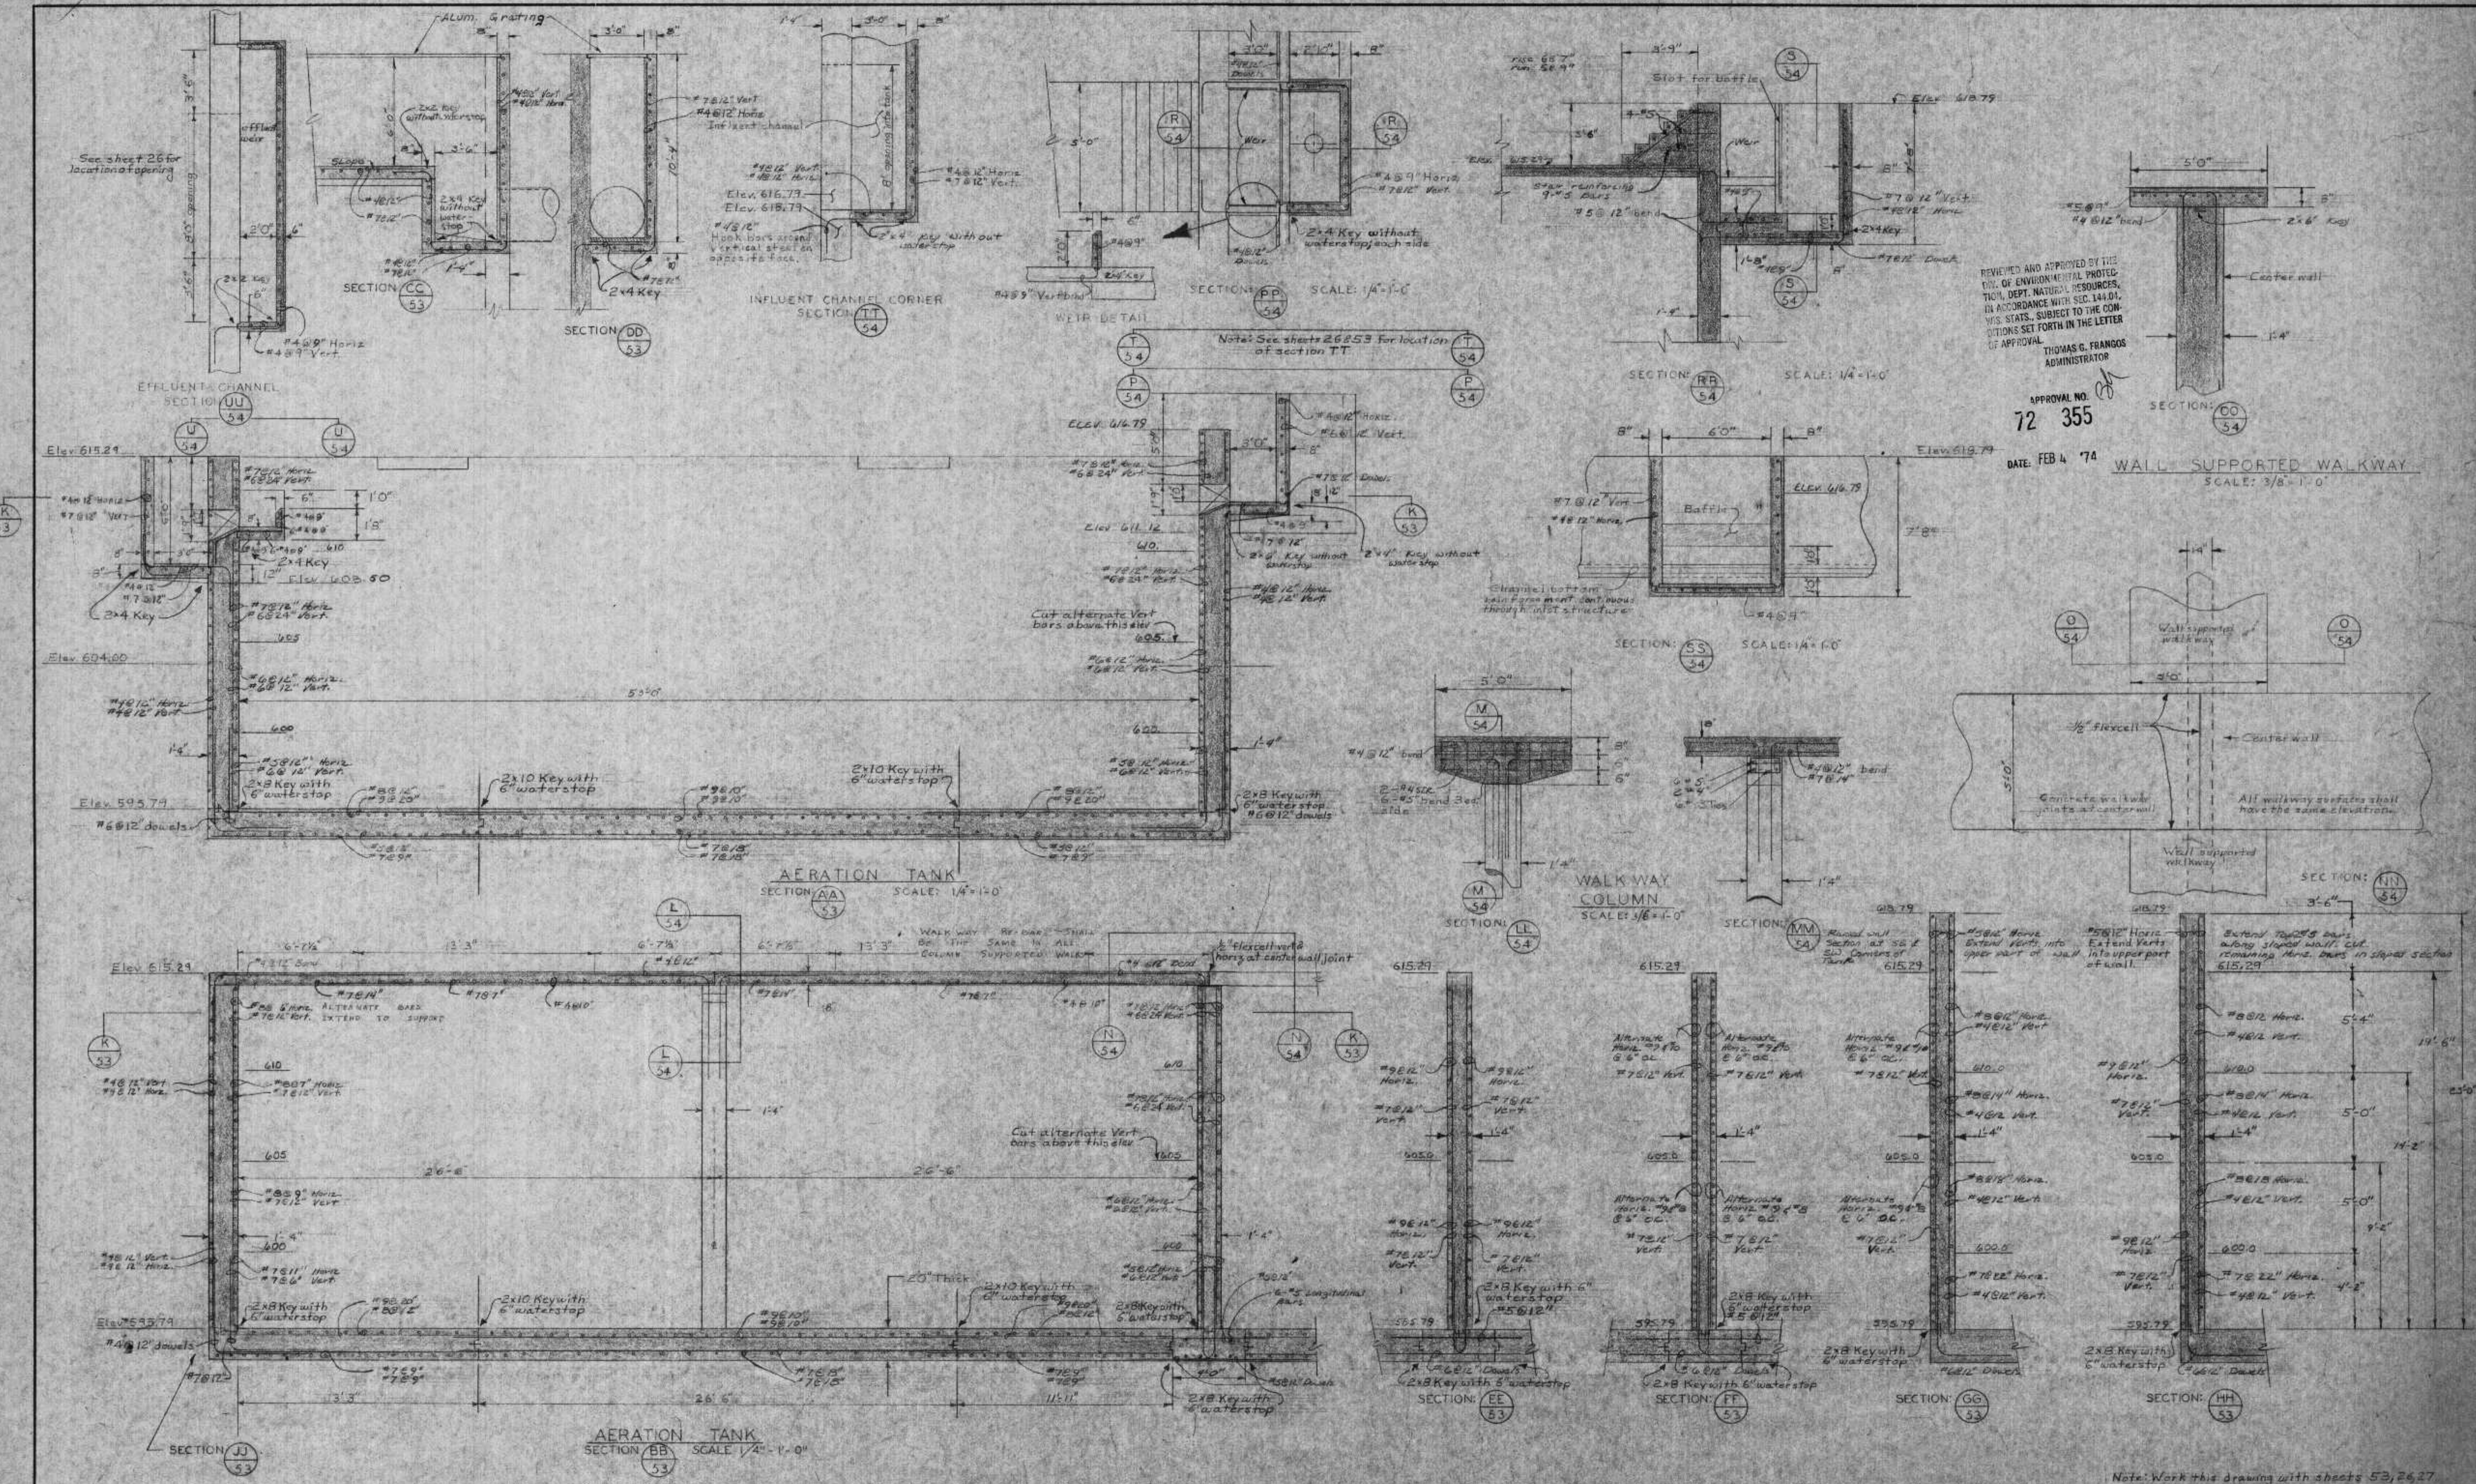

REVIEWED AND APPROVED BY THE
 DIV. OF ENVIRONMENTAL PROTECTION,
 DEPT. NATURAL RESOURCES,
 IN ACCORDANCE WITH SEC. 144.01,
 WIS. STATS., SUBJECT TO THE CON-
 DITIONS SET FORTH IN THE LETTER
 OF APPROVAL



THOMAS G. FRANGOS
 ADMINISTRATOR

APPROVAL NO.
 72 355
 DATE: FEB 4 '74

WALL SUPPORTED WALKWAY
 SCALE: 3/8" = 1'-0"

SECTION NN SCALE: 3/8" = 1'-0"



Note: Work this drawing with sheets 53, 26, 27

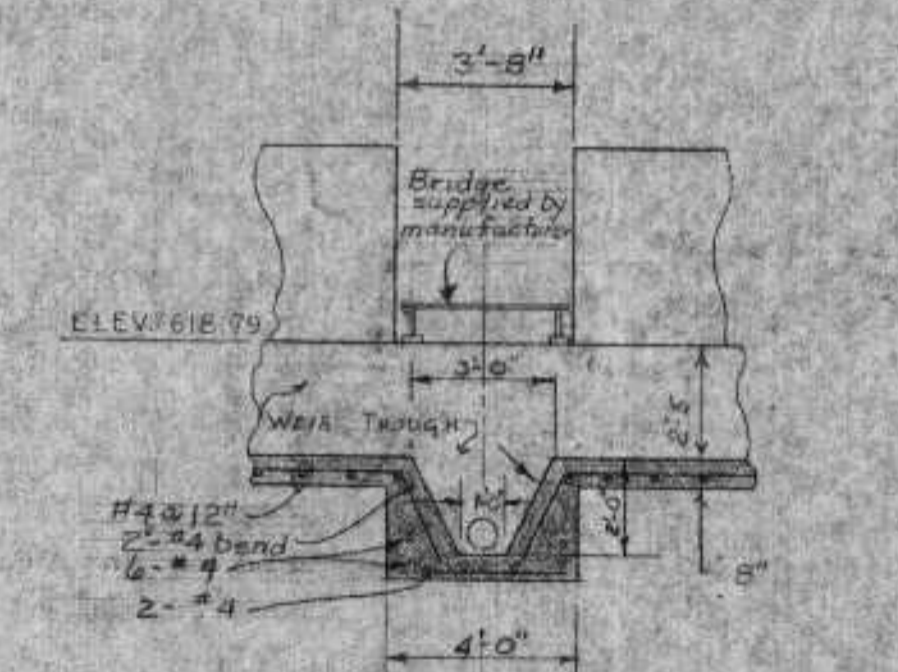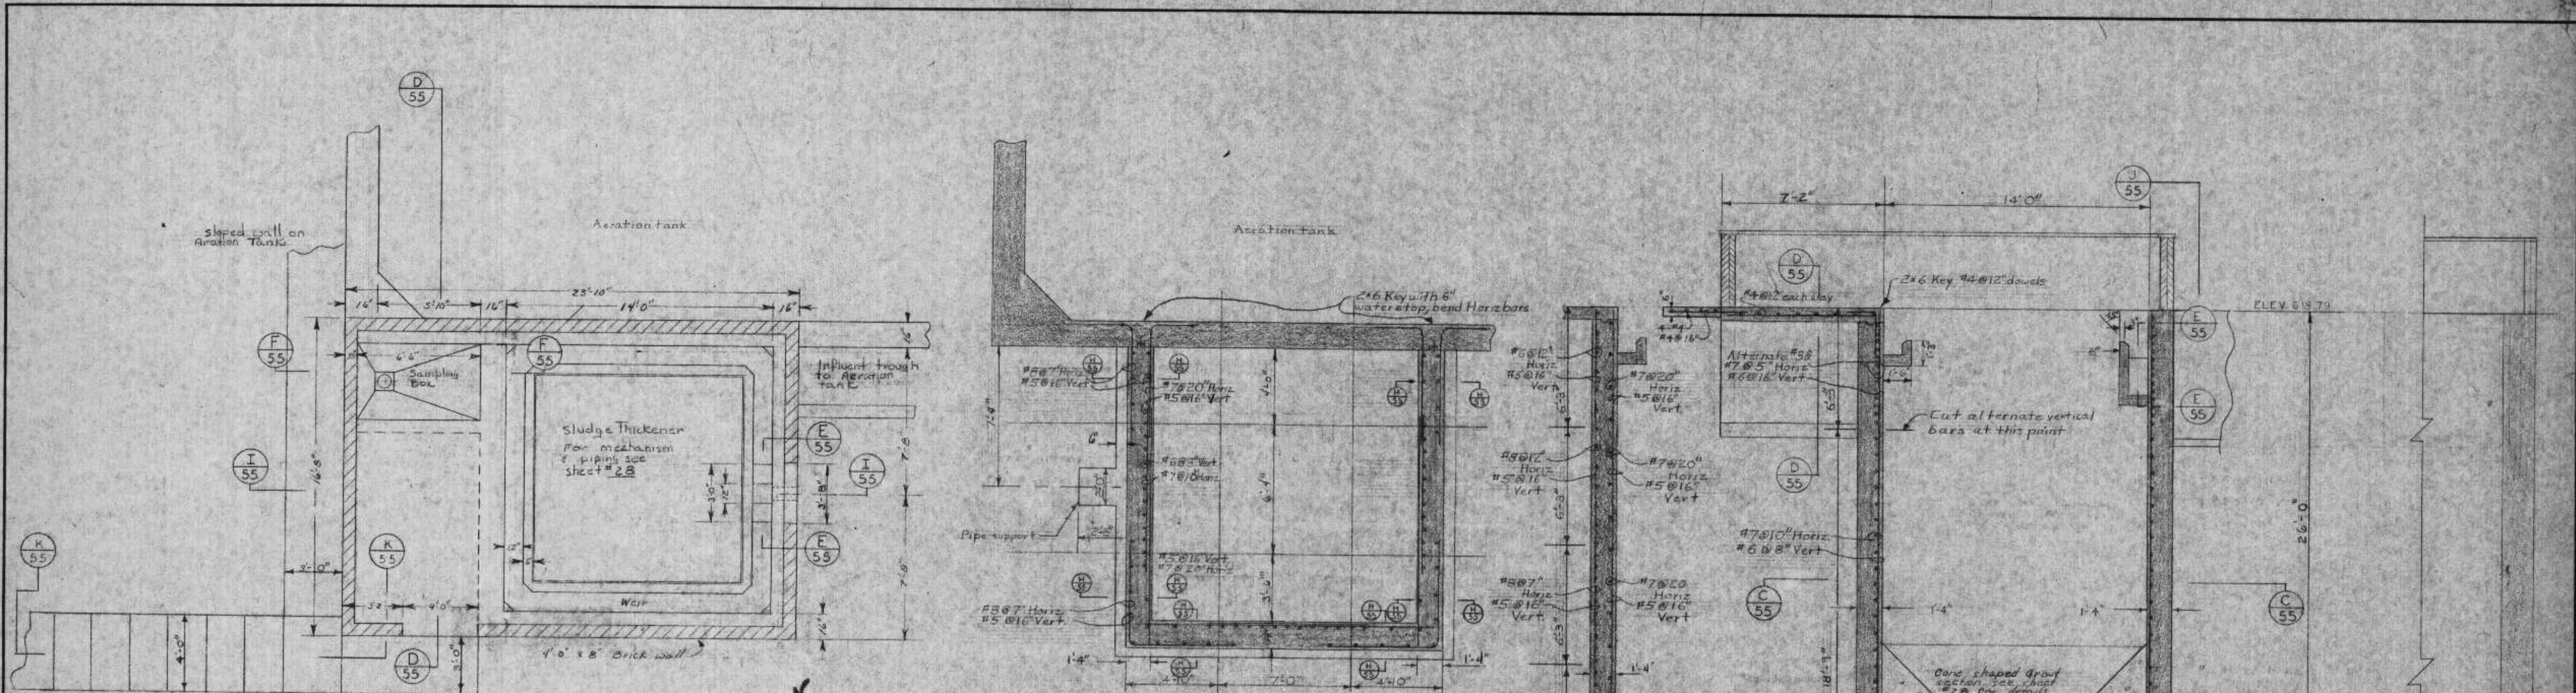

REVIEWED AND APPROVED BY THE
CITY OF ENVIRONMENTAL PROTECTION,
DEPT. NATURAL RESOURCES,
IN ACCORDANCE WITH SEC. 144.04,
WIS. STATE, SUBJECT TO THE CON-
DITIONS SET FORTH IN THE LETTER
OF APPROVAL.
THOMAS G. FRANGOS
ADMINISTRATOR

APPROVAL NO.
72 355

DATE: FEB 4 '74

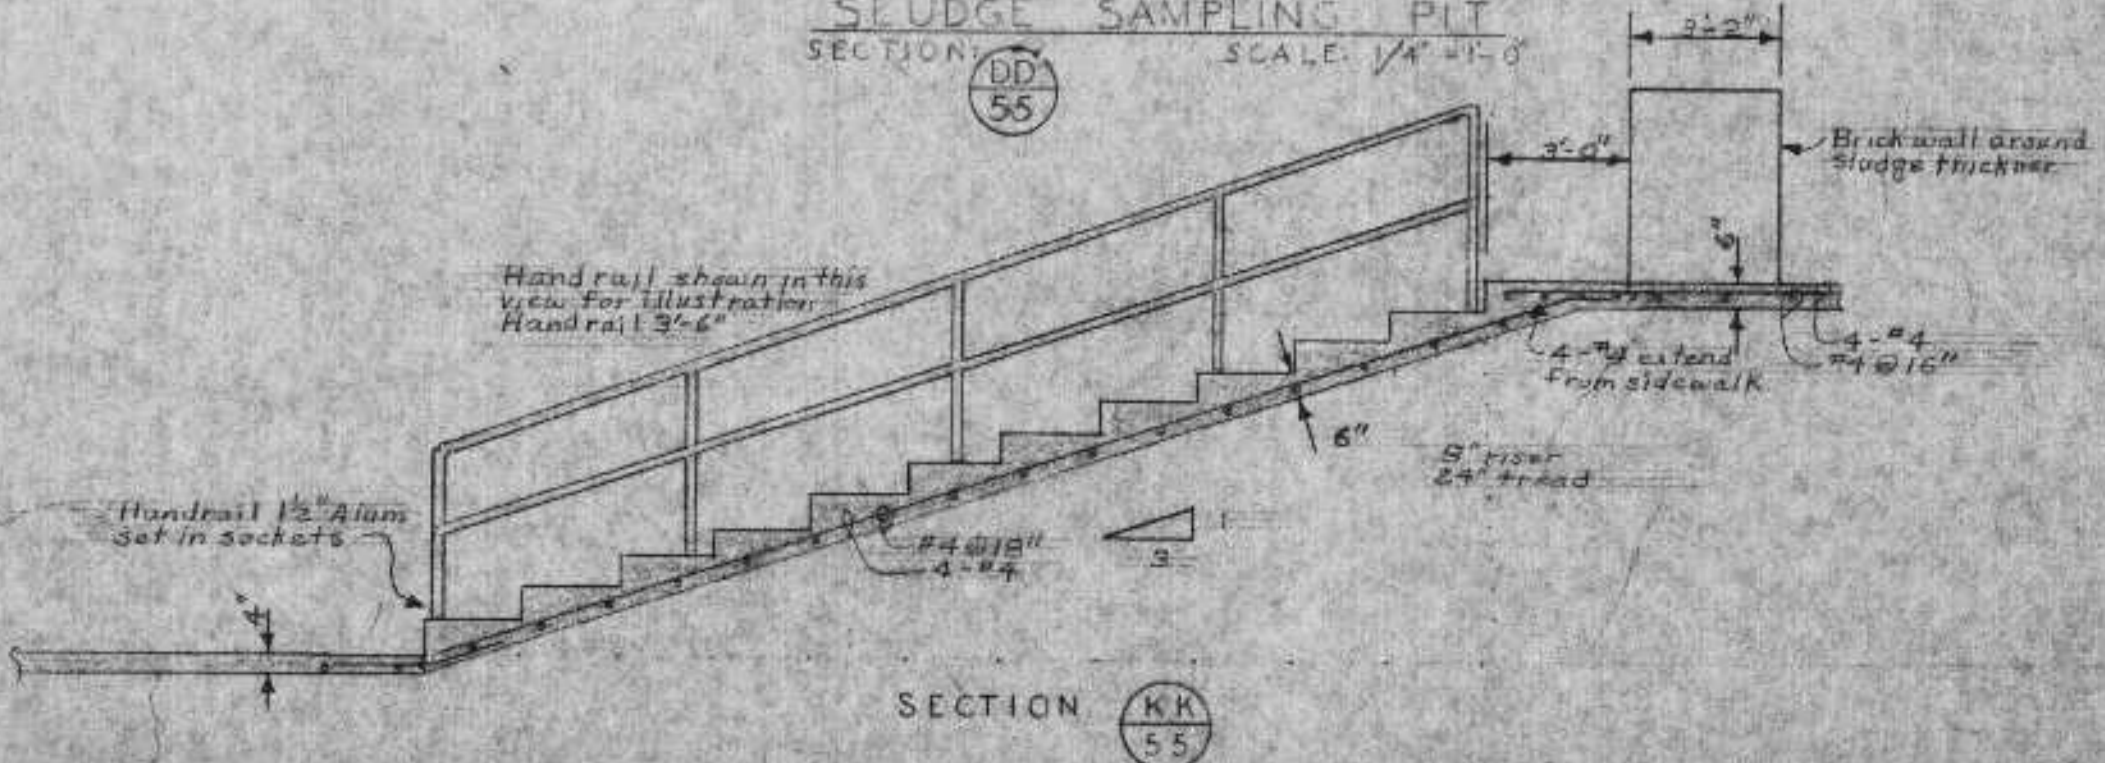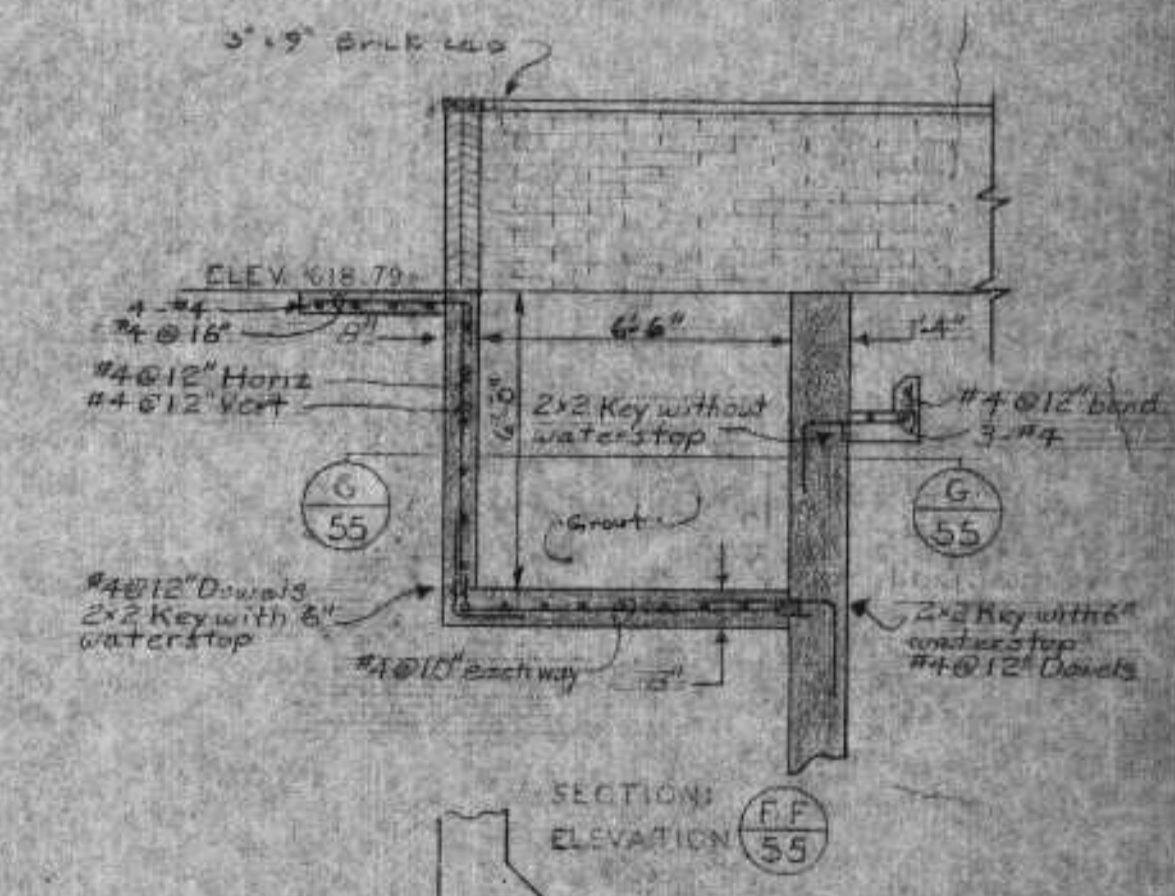

DNR JAN 3 1974

NOTE: Work this drawing with sheet no. 2B